

RISH EM 1320/30/40

Multi-Function Energy Meter

Technical Datasheet



Compact True RMS Energy Meter for Energy Monitoring

RISH EM series is specially designed for Active, Reactive and Apparent Energy Measurement including per phase THD, Powers and others parameters as per different models.

- ▼ True RMS Measurement
- ▼ Energy as per IEC 62053
- ▼ Onsite Programmable
- ▼ Low Back Depth
- ▼ Phase Reversal Indication
- ▼ LCD Display with Back-lit
- ▼ RS485, Limit or Pulse Output



RISHABH
INSTRUMENTS
Measure, Control & Record with a Difference

Preliminary Datasheet subject to change without notice

RISHABH INSTRUMENTS PVT.LTD.
F-31, MIDC, Satpur, Nashik-422 007, India.
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064
E-mail : India :- marketing@rishabh.co.in
International :- exp.marketing@rishabh.co.in
www.rishabh.co.in

RISH EM 1320/30/40

Multi-Function Energy Meter



RISH EM series measures important electrical parameters in 3 phase and single phase Network & replaces the multiple analog panel meters. It measures electrical parameters like Active / Reactive / Apparent energy , power as per models. The instrument has optional output as one pulse output for energy measurement.

Applications:

- Energy billing
- Electrical load monitoring
- Sub-metering
- Genset, Test Benches and Laboratories

Product Features:

True RMS measurement:

- Measures distorted waveform up to 15th Harmonic.

Energy as per IEC 62053:

- Independent Import and Export Energy counter.
- Active energy (kWh), Reactive energy (kVArh), Apparent energy (kVAh) measurement.
- Accuracy as per IEC 62053-21,IEC62053-23.

THD Measurement:

- The instrument measures THD per phase voltage & current up to 15th Harmonic.

Onsite programmable:

- Onsite Programmable System Configuration 3PH4W / 3PH3W / 1PH2W.
- Onsite Programmable CT ratios and PT ratios

Direct remote access(Optional):

- Remote configuration of the Instrument via MODBUS.
- Remote access of measured parameters. Programmable baud rates up to 38.4kbps.

Limit (Alarm) or Pulse Relay Output(Optional):

- Potential free, very fast acting relay contact.
- Configurable as pulse output which can be used to drive an external counter for energy measurement.
- Configurable as limit (alarm) switch.

Low back depth:

- The instrument has very low back depth (behind the panel) of less than 35 mm.

User Configurable Features:

- User can select any five or ten measurement screens which will be shown on display. Also backlit can be programmed to switched on or off.

LCD Display with Backlit:

- LCD shows 3 Parameters at a glance.

Parameter Screen recall:

- In case of power failure, the instrument memorizes the last displayed screen.

Run Hour, ON Hour, Number of Interruptions:

- Run Hour records the number of hours load is connected. ON Hour is the period for which the auxiliary supply is ON. Number of Interruptions indicates the number of times the Auxiliary Supply was interrupted.

Onsite selection of Auto scroll / Fixed Screen

- User can set the display in auto scrolling mode or fixed screen mode locally via front panel keys by entering into Programming mode or remotely via MODBUS (Rs485).

Enclosure Protection for dust and water:

- Conforms to IP 50 (front face) as per IEC60529

Compliance to International Safety standards

- Compliance to International Safety standard IEC 61010-1- 2010

EMC Compatibility

- Compliance to International standard IEC 61326



RISHABH
INSTRUMENTS
Measure, Control & Record with a Difference

Preliminary Datasheet subject to change without notice

RISHABH INSTRUMENTS PVT.LTD.
F-31, MIDC, Satpur, Nashik-422 007, India.
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064
E-mail : India :- marketing@rishabh.co.in
International :- exp.marketing@rishabh.co.in
www.rishabh.co.in


Page 2 of 8

Version: I 23/09/14


RISH EM 1320/30/40

Multi-Function Energy Meter


Dimensions Details:

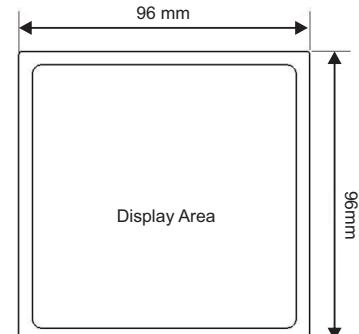

Front View

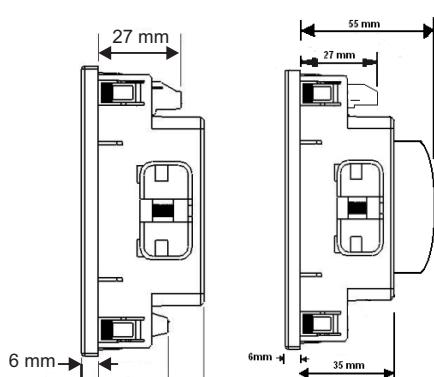

Side View

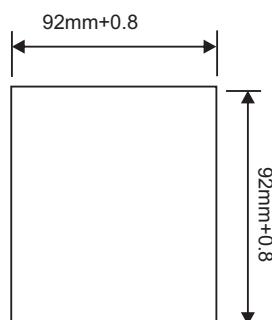

Panel Cutout

Technical Specifications:

Input Voltage:

| Nominal input voltage (AC RMS) | Phase -Neutral | Line-Line |
|--------------------------------|----------------------|-----------|
| 63.5 V _{L-N} | 110 V _{L-L} | |
| 133 V _{L-N} | 230 V _{L-L} | |
| 239.6 V _{L-N} | 415 V _{L-L} | |

System PT primary values 100VLL to 1200kVLL programmable on site.

Max continuous input voltage 120% of nominal value

Input Current:

| | |
|------------------------------|--|
| Nominal input current | 1A/5A AC RMS |
| System CT primary values | From 1A to 9999A |
| Max continuous input current | 120% of nominal value |
| Overload Indication | "-OL-" >121% of Nominal value (for voltage and current) |

Auxiliary Supply:

| | |
|--------------------------|---------------------------------------|
| External Higher Aux | 60 V – 300V AC/DC ($\pm 5\%$ approx) |
| Higher Aux Nominal Value | 230 V AC/DC 50/60 Hz for AC Aux |
| OR | |
| External Lower Aux | 20V – 60 V DC / 20V – 40 V AC |
| Lower Aux Nominal Value | 48 V DC / 24 V AC 50/60 Hz for AC Aux |
| Aux Supply frequency | 45 to 65 Hz range |

VA Burden:

| | |
|------------------------------|----------------------------|
| Nominal input voltage burden | < 0.3 VA approx. per phase |
| Nominal input current burden | < 0.3 VA approx. per phase |
| Auxiliary Supply burden | |
| With Addon card | < 6VA approx. |
| Without Addon card | < 4VA approx. |

Operating Measuring Ranges:

| | |
|---|---|
| Current (Energy Measurement) (As per IEC 62053-21) | Starting current : 2mA for 1A & 10mA for 5A Range: 20mA to 1.2A for 1A 100mA to 6A for 5A |
| Voltage | 50... 120% of nominal value |
| Power Factor | 0.5 Lag ... 1... 0.8 Lead |
| Frequency | 50Hz / 60Hz |
| Total Harmonic Distortion | 0.....50% |

Accuracy :

| | |
|---|---|
| Reference Conditions (As per IEC 62053 - 21) | 23°C +/- 2°C |
| Active Energy | Class 1 as per IEC 62053 - 21 |
| Reactive Energy | Class 2 as per IEC 62053 - 23 |
| Apparent Energy | Class 1 |
| Active Power | $\pm 0.5\%$ of nominal value at $\cos \phi = 1$ |
| Re-Active Power | $\pm 1.0\%$ of nominal value at $\sin \phi = 1$ |
| Apparent Power | $\pm 0.5\%$ of nominal value |
| Power Factor/Phase Angle | $\pm 3^\circ$ |
| Voltage | $\pm 0.5\%$ of nominal value |
| Current | $\pm 0.5\%$ of nominal value |
| Frequency | $\pm 0.2\%$ of mid frequency |
| THD (Voltage / Current) | $\pm 2.0\%$ |



Measure, Control & Record with a Difference



Preliminary Datasheet subject to change without notice

RISHABH INSTRUMENTS PVT.LTD.
F-31, MIDC, Satpur, Nashik-422 007, India.
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064
E-mail : India :- marketing@rishabh.co.in
International :- exp.marketing@rishabh.co.in
www.rishabh.co.in

RISH EM 1320/30/40


Multi-Function Energy Meter

Installation:

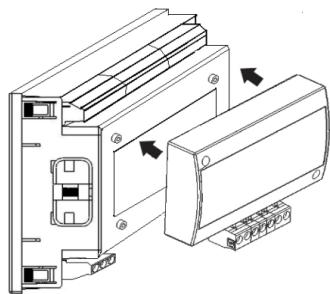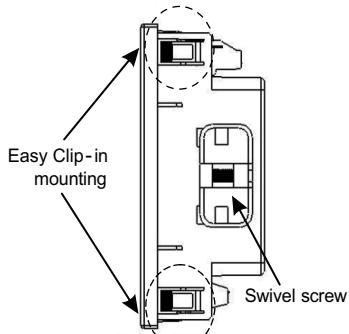


Optional Modbus/Pulse output pluggable module.


Electrical Connection:

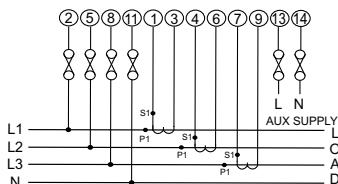

3 Phase 4 wire Unbalanced load

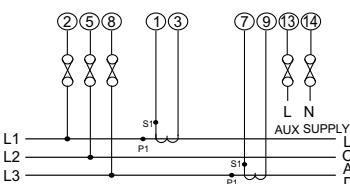

3 Phase 3 wire Unbalanced load

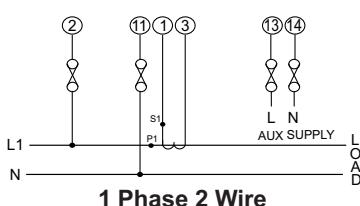

1 Phase 2 Wire

Technical Specifications:

Overload Withstand:

| | |
|---------|--|
| Voltage | 2 x rated value for 1 second, repeated 10 times at 10 second intervals |
| Current | 20x Imax for 0.5sec |

Display update rate:

| | |
|-----------------------------|---------------|
| Response time to step input | 1 sec approx. |
|-----------------------------|---------------|

Applicable Standards:

| | |
|----------------------------|---|
| EMC | IEC 61326 - 1 : 2005 |
| Immunity | IEC 61000-4-3. 10V/m min – Level 3 industrial Low level |
| Safety | IEC 61010-1-2010 , Permanently connected use |
| IP for water & dust | IEC60529 |
| Pollution degree: | 2 |
| Installation category: | III |
| Isolation: | 2 |
| Protective Class | 2 |
| High Voltage Test | |
| Input+Aux Vs Surface | 4kV RMS, 50Hz,1min |
| Input Vs Remaining Circuit | 2kV RMS,50Hz,1min |

Environmental

| | |
|------------------------------|--|
| Operating temperature | -10 to +55°C |
| Storage temperature | -20 to +65°C |
| Relative humidity | 0... 90%RH (non condensing) |
| Warm up time | Minimum 3 minute |
| Shock (As per IEC60068-2-27) | Half sine wave,Peak acceleration 30gn (300 m/s^2),duration 18ms. |
| Vibration | 10... 150... 10 Hz, 0.15mm amplitude |
| Number of Sweep cycles | 10 per axis |
| Enclosure | IP 50 (front face only) |

Interfaces

| | |
|-------------------|--|
| Impulse Led | For Energy Calibration at front |
| Relay(Optional) | 240 VAC ,5 A(Configured as limit or pulse output) |
| Modbus (Optional) | RS485,max.1200m Baud rate : 4.8k,9.6k,19.2k,38.4k bps |

NOTE: Variation due to influence Quantity is 100% of class index for all other parameters except Energy.

PT Secondary Ranges for Various Input Voltage:

| Input Voltage | PT Secondary Settable Range |
|-----------------------|-----------------------------------|
| 110V L-L (63.5V L-N) | 100V – 125V L-L (57V – 72V L-N) |
| 230V L-L (133V L-N) | 126V – 250V L-L (73V – 144V L-N) |
| 415V L-L (239.6V L-N) | 251V – 480V L-L (145V – 277V L-N) |

Input connections are made directly to screw-type terminals with indirect wire pressure. Numbering is clearly marked on the connector . Choice of cable should meet local regulations. Terminal for both Current and Voltage inputs will accept up to 4mm² (12AWG) solid or 2.5 mm² standard cable.

Note: It is recommended to use wire with lug for connection with meter.



RISHABH
INSTRUMENTS
Measure, Control & Record with a Difference

Preliminary Datasheet subject to change without notice

RISHABH INSTRUMENTS PVT.LTD.
F-31, MIDC, Satpur, Nashik-422 007,India.
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064
E-mail : India :- marketing@rishabh.co.in
International :- exp.marketing@rishabh.co.in
www.rishabh.co.in

Page 4 of 8

Version: I 23/09/14

RISH EM 1320/30/40

Multi-Function Energy Meter

Measured Parameter System wise:

✓ : Available

✗ : Not Available

| Sr No | Displayed Parameters | 3 Phase 4Wire | 3Phase 3Wire | 1Phase 2Wire |
|-------|-----------------------------------|---------------|--------------|--------------|
| 1. | Import Active Energy (kWh) | ✓ | ✓ | ✓ |
| 2. | Export Active Energy (kWh) | ✓ | ✓ | ✓ |
| 3. | Inductive Reactive Energy (kVAh) | ✓ | ✓ | ✓ |
| 4. | Capacitive Reactive Energy (kVAh) | ✓ | ✓ | ✓ |
| 5. | Apparent Energy (kVAh) | ✓ | ✓ | ✓ |
| 6. | System Active Power (kW) | ✓ | ✓ | ✓ |
| 7. | Active Power L1 (kW) | ✓ | ✗ | ✗ |
| 8. | Active Power L2 (kW) | ✓ | ✗ | ✗ |
| 9. | Active Power L3 (kW) | ✓ | ✗ | ✗ |
| 10. | System Re-active Power (kVAr) | ✓ | ✓ | ✓ |
| 11. | Re-active Power L1 (kVAr) | ✓ | ✗ | ✗ |
| 12. | Re-active Power L2 (kVAr) | ✓ | ✗ | ✗ |
| 13. | Re-active Power L3 (kVAr) | ✓ | ✗ | ✗ |
| 14. | System Apparent Power (kVA) | ✓ | ✓ | ✓ |
| 15. | Apparent Power L1 (kVA) | ✓ | ✗ | ✗ |
| 16. | Apparent Power L2 (kVA) | ✓ | ✗ | ✗ |
| 17. | Apparent Power L3 (kVA) | ✓ | ✗ | ✗ |
| 18. | System Power Factor | ✓ | ✓ | ✓ |
| 19. | Power Factor L1 | ✓ | ✗ | ✗ |
| 20. | Power Factor L2 | ✓ | ✗ | ✗ |
| 21. | Power Factor L3 | ✓ | ✗ | ✗ |
| 22. | System Phase Angle | ✓ | ✓ | ✓ |
| 23. | Phase Angle L1 | ✓ | ✗ | ✗ |
| 24. | Phase Angle L2 | ✓ | ✗ | ✗ |
| 25. | Phase Angle L3 | ✓ | ✗ | ✗ |
| 26. | Current Demand | ✓ | ✓ | ✓ |
| 27. | kVA Demand | ✓ | ✓ | ✓ |
| 28. | Import kW Demand | ✓ | ✓ | ✓ |
| 29. | Export kW Demand | ✓ | ✓ | ✓ |
| 30. | Max Current Demand | ✓ | ✓ | ✓ |
| 31. | Max kVA Demand | ✓ | ✓ | ✓ |
| 32. | Max Import kW Demand | ✓ | ✓ | ✓ |
| 33. | Max Export kW Demand | ✓ | ✓ | ✓ |
| 34. | Run Hour | ✓ | ✓ | ✓ |
| 35. | On Hour | ✓ | ✓ | ✓ |
| 36. | Number of Interruptions | ✓ | ✓ | ✓ |
| 37. | System Voltage | ✓ | ✓ | ✓ |
| 38. | Voltage L1 | ✓ | ✗ | ✗ |
| 39. | Voltage L2 | ✓ | ✗ | ✗ |
| 40. | Voltage L3 | ✓ | ✗ | ✗ |
| 41. | Voltage L12 | ✓ | ✓ | ✗ |
| 42. | Voltage L23 | ✓ | ✓ | ✗ |
| 43. | Voltage L31 | ✓ | ✓ | ✗ |
| 44. | System Voltage THD | ✓ | ✓ | ✓ |
| 45. | Voltage L1 THD | ✓ | ✓ | ✗ |
| 46. | Voltage L2 THD | ✓ | ✓ | ✗ |
| 47. | Voltage L3 THD | ✓ | ✓ | ✗ |



RISHABH
INSTRUMENTS

Measure, Control & Record with a Difference

Preliminary Datasheet subject to change without notice

RISHABH INSTRUMENTS PVT.LTD.
F-31, MIDC, Satpur, Nashik-422 007, India.
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064
E-mail : India :- marketing@rishabh.co.in
International :- exp.marketing@rishabh.co.in
www.rishabh.co.in

RISH EM 1320/30/40

Multi-Function Energy Meter

Measured Parameter System wise:

✓ : Available ✗ : Not Available

| Sr No | Displayed Parameters | 3 Phase 4Wire | 3Phase 3Wire | 1Phase 2Wire |
|-------|--|---------------|--------------|--------------|
| 48. | System Current | ✓ | ✓ | ✓ |
| 49. | Current L1 | ✓ | ✓ | ✗ |
| 50. | Current L2 | ✓ | ✓ | ✗ |
| 51. | Current L3 | ✓ | ✓ | ✗ |
| 52. | System Current THD | ✓ | ✓ | ✓ |
| 53. | Current L1 THD | ✓ | ✓ | ✗ |
| 54. | Current L2 THD | ✓ | ✓ | ✗ |
| 55. | Current L3 THD | ✓ | ✓ | ✗ |
| 56. | Neutral Current | ✓ | ✗ | ✗ |
| 57. | Frequency | ✓ | ✓ | ✓ |
| 58. | RPM | ✓ | ✓ | ✓ |
| 59. | Phase Reversal Indication | ✓ | ✓ | ✗ |
| 60. | Current Reversal Indication | ✓ | ✓ | ✓ |
| 61. | Phase Absent Indication | ✓ | ✓ | ✗ |
| 62. | Old Import Active Energy (kWh) | ✓ | ✓ | ✓ |
| 63. | Old Export Active Energy (kWh) | ✓ | ✓ | ✓ |
| 64. | Old Inductive Reactive Energy (kVArh) | ✓ | ✓ | ✓ |
| 65. | Old Capacitive Reactive Energy (kVArh) | ✓ | ✓ | ✓ |
| 66. | Old Apparent Energy (kVAh) | ✓ | ✓ | ✓ |
| 67. | Old Run Hour | ✓ | ✓ | ✓ |
| 68. | Old On Hour | ✓ | ✓ | ✓ |
| 69. | Old Number of Interruptions | ✓ | ✓ | ✓ |

Measured Parameter Model wise:

| Sr. No | Parameters | EM 1320 | | EM 1330 | | EM 1340 | |
|--------|------------------------------------|------------|-----------|------------|-----------|------------|-----------|
| | | On Display | On Modbus | On Display | On Modbus | On Display | On Modbus |
| 1. | Import Active Energy (kWh) | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 2. | Export Active Energy (kWh) | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 3. | Inductive Reactive Energy (kVArh) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 4. | Capacitive Reactive Energy (kVArh) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 5. | Apparent Energy (kVAh) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 6. | System Active Power (kW) | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 7. | Active Power L1 (kW) | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 8. | Active Power L2 (kW) | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 9. | Active Power L3 (kW) | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 10. | System Re-active Power (kVAr) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 11. | Re-active Power L1 (kVAr) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 12. | Re-active Power L2 (kVAr) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 13. | Re-active Power L3 (kVAr) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 14. | System Apparent Power (kVA) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 15. | Apparent Power L1 (kVA) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 16. | Apparent Power L2 (kVA) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 17. | Apparent Power L3 (kVA) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 18. | System Power Factor | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 19. | Power Factor L1 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 20. | Power Factor L2 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 21. | Power Factor L3 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |



RISHABH
INSTRUMENTS

Measure, Control & Record with a Difference

RISH EM 1320/30/40

Multi-Function Energy Meter

Measured Parameter Model wise:

✓ : Available

✗ : Not Available

| Sr. No | Parameters | EM 1320 | | EM 1330 | | EM 1340 | |
|--------|--|------------|-----------|------------|-----------|------------|-----------|
| | | On Display | On Modbus | On Display | On Modbus | On Display | On Modbus |
| 22. | System Phase Angle | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 23. | Phase Angle L1 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 24. | Phase Angle L2 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 25. | Phase Angle L3 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 26. | Current Demand | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 27. | kVA Demand | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 28. | Import kW Demand | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 29. | Export kW Demand | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 30. | Max Current Demand | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 31. | Max kVA Demand | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 32. | Max Import kW Demand | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 33. | Max Export kW Demand | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 34. | Run Hour | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 35. | On Hour | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 36. | Number of Interruptions | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 37. | System Voltage | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 38. | Voltage L1 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 39. | Voltage L2 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 40. | Voltage L3 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 41. | Voltage L12 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 42. | Voltage L23 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 43. | Voltage L31 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 44. | System Voltage THD | ✗ | ✗ | ✗ | ✗ | ✓ | ✓ |
| 45. | Voltage L1 THD | ✗ | ✗ | ✗ | ✗ | ✓ | ✓ |
| 46. | Voltage L2 THD | ✗ | ✗ | ✗ | ✗ | ✓ | ✓ |
| 47. | Voltage L3 THD | ✗ | ✗ | ✗ | ✗ | ✓ | ✓ |
| 48. | System Current | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 49. | Current L1 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 50. | Current L2 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 51. | Current L3 | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 52. | System Current THD | ✗ | ✗ | ✗ | ✗ | ✓ | ✓ |
| 53. | Current L1 THD | ✗ | ✗ | ✗ | ✗ | ✓ | ✓ |
| 54. | Current L2 THD | ✗ | ✗ | ✗ | ✗ | ✓ | ✓ |
| 55. | Current L3 THD | ✗ | ✗ | ✗ | ✗ | ✓ | ✓ |
| 56. | Neutral Current | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 57. | Frequency | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 58. | RPM | ✗ | ✓ | ✓ | ✓ | ✓ | ✓ |
| 59. | Phase Reversal Indication | ✓ | ✗ | ✓ | ✗ | ✓ | ✗ |
| 60. | Current Reversal Indication | ✓ | ✗ | ✓ | ✗ | ✓ | ✗ |
| 61. | Phase Absent Indication | ✓ | ✗ | ✓ | ✗ | ✓ | ✗ |
| 62. | Old Import Active Energy (kWh) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 63. | Old Export Active Energy (kWh) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 64. | Old Inductive Reactive Energy (kVArh) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 65. | Old Capacitive Reactive Energy (kVArh) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 66. | Old Apparent Energy (kVAh) | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 67. | Old Run Hour | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 68. | Old On Hour | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |
| 69. | Old Number of Interruptions | ✗ | ✓ | ✗ | ✓ | ✓ | ✓ |



**RISHABH
INSTRUMENTS**
Measure, Control & Record with a Difference

Preliminary Datasheet subject to change without notice

RISHABH INSTRUMENTS PVT.LTD.
F-31, MIDC, Satpur, Nashik-420 007, India.
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064
E-mail : India :- marketing@rishabh.co.in
International :- exp.marketing@rishabh.co.in
www.rishabh.co.in

Page 7 of 8

Version: I 23/09/14

RISH EM 1320/30/40

Multi-Function Energy Meter

Ordering Information:

| | | | | | | | | |
|----------------------|--------------------|---|---|---|---|---|---|--------|
| Order Code | WH00- | X | X | X | X | X | X | 000000 |
| Product Type | RISH EM 1320 | 2 | | | | | | |
| | RISH EM 1330 | 3 | | | | | | |
| | RISH EM 1340 | 4 | | | | | | |
| System Type | 3PH 3W/4W | | 3 | | | | | |
| | 1 Phase | | 1 | | | | | |
| Input Voltage | 63.5VL-N | | 1 | | | | | |
| | 133VL-N | | 2 | | | | | |
| | 230VL-N | | 3 | | | | | |
| | 239.6VL-N | | 4 | | | | | |
| | 254VL-N | | 5 | | | | | |
| | 110VL-L | | 6 | | | | | |
| | 230VL-L | | 7 | | | | | |
| | 415VL-L | | 8 | | | | | |
| | 440VL-L | | 9 | | | | | |
| Input Current | 5A / 1A | | 5 | | | | | |
| Power Supply | 60 - 300V AC/DC | | | U | | | | |
| RS 485 | With RS 485 | | | | R | | | |
| | Without RS 485 | | | | Z | | | |
| Pulse Output | Pulse output | | | | P | | | |
| | Pulse O/P not used | | | | Z | | | |

Order Code Examples:

1. WH00-4385URP000000

RISH EM 1340, 3PH 3W/4W, 415VL-L, 5A / 1A, With RS 485, Pulse output

2. WH00-3335URP000000

RISH EM 1330, 1 Phase, 230VL-N, 5A / 1A, With RS 485, Pulse output



**RISHABH
INSTRUMENTS**
Measure, Control & Record with a Difference

Preliminary Datasheet subject to change without notice

RISHABH INSTRUMENTS PVT.LTD.
F-31, MIDC, Satpur, Nashik-422 007, India.
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064
E-mail : India :- marketing@rishabh.co.in
International :- exp.marketing@rishabh.co.in
www.rishabh.co.in

Page 8 of 8

Version: I 23/09/14